

R2A3

Product Specifications

EFFICIENT 13 SEER AIR CONDITIONER

1½ THRU 5 TONS SPLIT SYSTEM

208 / 230 Volt, 1-phase, 60 Hz

REFRIGERATION CIRCUIT

- Dependable compressors on all models
- Copper tube / aluminum fin coil

EASY TO INSTALL AND SERVICE

- Easy Access service valves on all models
- External high and low refrigerant service ports
- Only two screws to access control panel
- Factory charged with R-22 refrigerant

BUILT TO LAST


- Pre-painted cabinet finish over galvanized steel
- Coated inlet grille with 2" spacing standard
- 5 year limited compressor, coil, and parts warranties



Rated in accordance with ARI Standard 210.
Certification applies only when used with proper
components as listed with ARI.



Model Number	Size (tons)	Nominal BTU/hr	Min. Circuit Ampacity	Max. Fuse or Breaker	Operating Dimensions height x width x depth (in)	Ship / Operating Weight (lbs)
R2A318AKA	1½	18,000	10.1	15	31½ x 22½ x 22½	124 / 114
R2A324AKA	2	24,000	14.3	20	31½ x 30 x 30	153 / 141
R2A330AKA	2½	30,000	18.4	25	34½ x 30 x 30	161 / 148
R2A336AKA	3	36,000	18.7	30	33 ¹⁵ / ₁₆ x 30 x 30	164 / 150
R2A342AKA	3½	42,000	25.4	40	33 ¹⁵ / ₁₆ x 30 x 30	220 / 205
R2A348AKA	4	48,000	30.2	40	39 ¹⁵ / ₁₆ x 30 x 30	244 / 228
R2A360AKA	5	60,000	32.7	50	43 ¹⁵ / ₁₆ x 30 x 30	269 / 252

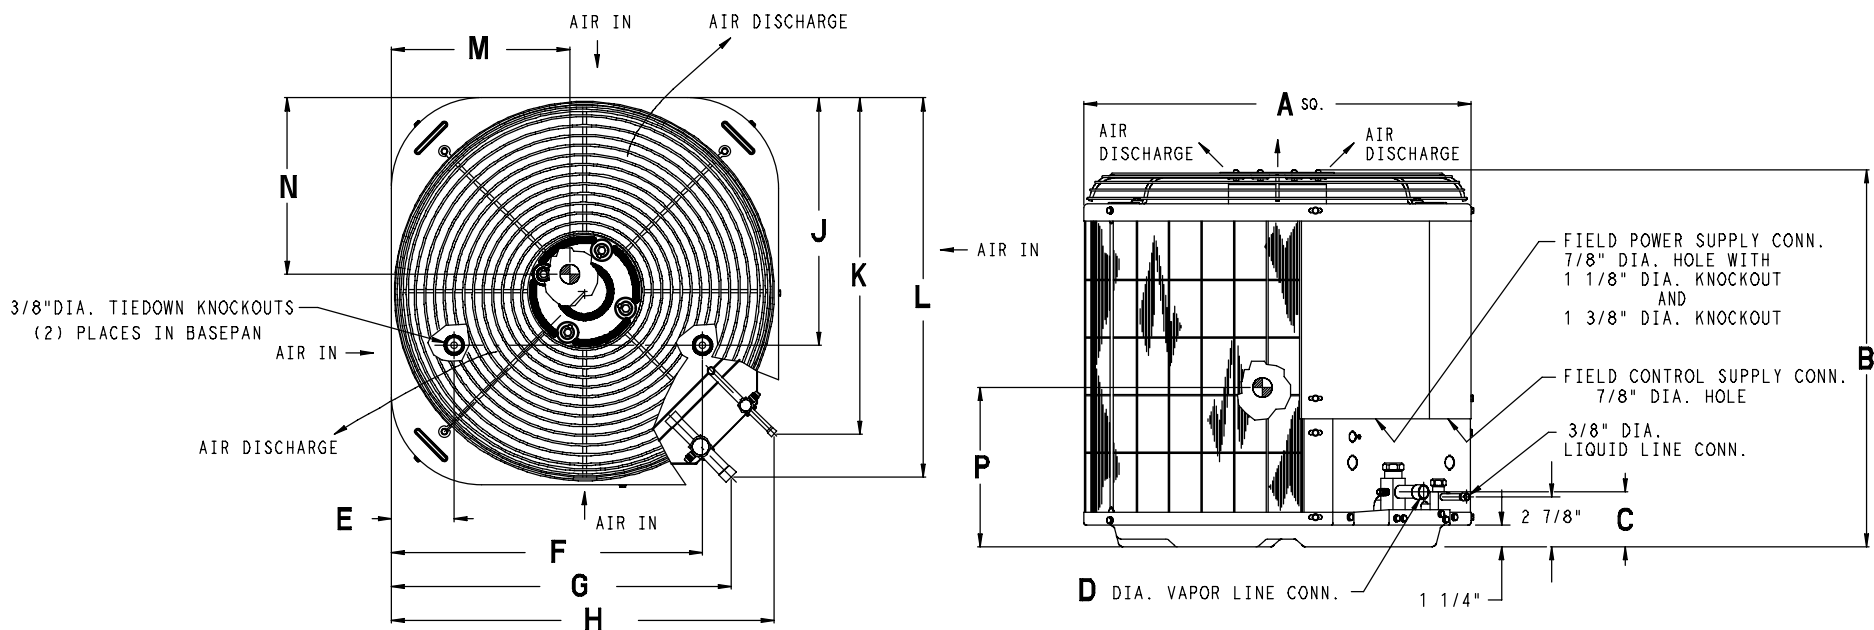

Model	All Dimensions Inches															Minimum Mounting Pad Size	Crated Dimensions B(h) x A(w) x A(d)
	A	B	C	D	E	F	G	H	J	K	L	M	N	P			
R2A318AKA	22½	31⅞	3⅜	5⁄8	3⅛	18⅞	19¾	22¼	14⅜	19⅞	22¼	10¼	9½	11½	22½ x 22½	31½ x 23½ x 23½	
R2A324AKA	30	31⅞	3⅜	5⁄8	6½	23½	27¼	29¾	20	27⅛	29⅞	14¾	14	10	30 x 30	31½ x 30½ x 30½	
R2A330AKA	30	34½	3⅜	¾	6½	23½	27¼	29¾	20	27⅛	29⅞	14¾	14	11	30 x 30	34⅜ x 30½ x 30½	
R2A336AKA	30	33⅛	3⅜	¾	6½	23½	27¼	29¾	20	27⅛	29⅞	15½	14	10	30 x 30	34 x 30½ x 30½	
R2A342AKA	30	33⅛	3¼	7⁄8	6½	23½	27¼	29¾	20	27⅛	29⅞	15½	14	12	30 x 30	34 x 30½ x 30½	
R2A348AKA	30	39⅛	3¼	7⁄8	6½	23½	27¼	29¾	20	27⅛	29⅞	15½	14	15	30 x 30	40 x 30½ x 30½	
R2A360AKA	30	43⅛	3¼	7⁄8	6½	23½	27¼	29¾	20	27⅛	29⅞	15½	14	15½	30 x 30	44½ x 30½ x 30½	

PHYSICAL DATA							
Model Size	18	24	30	36	42	48	60
Nominal Cooling Capacity (BTU/hr)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Nominal SEER	13.0	13.0	13.0	13.0	13.0	13.0	13.0
Sound Rating (dBA)	76	76	76	79	80	80	80
PSC Fan Motor HP	1/12	1/8	1/8	1/5	1/4	1/4	1/4
Fan RPM (single speed)	1100	825	825	825	1100	1100	1100
Fan CFM	1800	2400	2400	2800	3400	3400	3400
Coil Face Area (ft ²)	11.26	16.79	18.89	18.49	18.50	22.20	24.66
Coil Rows – fins per inch	1 – 25	1 – 25	1 – 25	1 – 25	2 – 20	2 – 20	2 – 20
Liquid Line Connection Size (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Vapor Line Connection Size (in.)	5/8	5/8	3/4	3/4	7/8	7/8	7/8
Recommended Line Set Liquid Tube Diameter (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Recommended Line Set Vapor Tube Diameter (in.)	5/8 *	5/8 *	3/4 *	3/4 *	7/8 *	7/8 *	1 1/8 *
* Recommended Vapor Tube Line size is for standard installations. These recommendations may not apply to “Long Line” installations. When the total equivalent line length exceeds 80 feet or there is more than 20 feet vertical separation between indoor and outdoor units, consult the Long Line Application Guideline document before purchasing/installing line sets.							
Factory Charge R-22 (lbs.)	4.88	5.38	5.63	8.00	11.95	12.83	17.37
Required Subcooling (°F)	10	10	10	10	10	10	10
Weight, shipping (lbs.)	124	153	161	164	220	244	269
Weight, operating (lbs.)	114	141	148	150	205	228	252

ELECTRICAL DATA (208/230-1-60, voltage range 197V – 253V)							
Model Size	18	24	30	36	42	48	60
Minimum Circuit Ampacity – MCA (amps)	10.1	14.3	18.4	18.7	25.4	30.2	32.7
Maximum OverCurrent Protective device – MOCP (amps)	15	20	25	30	40	40	50
Compressor RLA (Rated Load Amps) LRA (Locked Rotor Amps)	7.7 40.3	10.8 45.2	14.1 68.0	14.4 77.0	19.2 104.0	23.0 115.0	25.0 150.0
Fan Motor FLA (Full Load Amps)	.5	.75	.75	1.1	1.4	1.4	1.4

R-22 COOLING CAPACITY LOSS FOR VARIOUS LINE LENGTHS & TUBE DIAMETERS													
Model Size	Liquid Line (in.)	Acceptable Vapor Line Sizes (in.)	Cooling Capacity Loss (%) at Total Equivalent Line Length (ft.) Refer to Long Line Application Guideline to calculate equivalent length										
			18	3/8	5/8	0	1	1	1	2	3	3	4
3/4	0	0			0	0	0	1	1	1	1	2	2
24	3/8	5/8	0	1	3	3	3	5	6	7	8	9	10
		3/4	0	0	0	0	1	1	1	2	2	3	3
30	3/8	3/4	0	1	1	1	2	3	3	4	5	5	6
		7/8	0	0	0	0	1	1	1	2	2	2	3
36	3/8	3/4	0	1	2	2	3	4	5	6	7	8	9
		7/8	0	0	1	1	1	2	2	3	3	4	4
42	3/8	3/4	1	2	3	3	4	5	7	8	9	10	11
		7/8	0	1	1	1	2	2	3	4	4	5	5
48	3/8	3/4	1	2	4	4	5	7	8	10	11	13	14
		7/8	0	1	2	2	2	3	4	5	5	6	7
		1 1/8	0	0	0	0	0	0	1	1	1	1	1
60	3/8	7/8	1	2	3	3	4	5	7	8	9	10	11
		1 1/8	0	0	1	1	1	1	2	2	2	3	3

* Applications are considered “Long Line” if the total equivalent tubing length exceeds 80 feet or there is more than 20 foot vertical separation between indoor and outdoor units). These applications require additional accessories and system modifications for reliable system operation.

Applications in shaded area may have height restrictions that limit allowable total equivalent length when outdoor unit is below indoor unit.

ACCESSORY USAGE GUIDELINES		
Accessory	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55° F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 80 ft.)
Crankcase Heater	Yes	Yes
Evaporator Freeze Thermostat	Yes	No
Winter Start Control	Yes **	No
Hard Start Kit (Capacitor & Relay)	Yes	Yes
Low Ambient Kit (Pressure Switch)	Yes	No
Support Feet, 4” tall	Recommended	No
Liquid Line Solenoid Valve	No	See Long-Line Application Guideline

* For Line Set lengths between 80 and 200 ft horizontal, or more than 20 ft indoor-outdoor vertical separation, refer to the Long Line Application Guideline document.

** Can only be installed in conjunction with Low Pressure Switch.

ACCESSORIES		
Part Number	Description	Used On Model Size
NASA003CH	Crankcase Heater for Compressor	18, 24, 30, 36
NASA001CH	Crankcase Heater for Compressor	42, 48, 60
NASA001SC	Start Component – PTC Device	ALL
NASA001FS	Evaporator Freeze Thermostat	ALL
NASA201PS	Low Pressure Switch	ALL
NASA202PS	High Pressure Switch	ALL
NASA201LS	Liquid Line Solenoid Valve	ALL
NASA001TD	Time Delay Relay, Indoor Blower	ALL
NASA001WS	Winter Start Control	ALL
NASA001AC	Anti-Cycle Timer (5 minute delay)	ALL
NASA201LA	Low Ambient Kit (Pressure Switch)	ALL
NASA003SC	Hard Start Kit (Capacitor & Relay)	18, 24, 36, 42, 48
NASA005SC	Hard Start Kit (Capacitor & Relay)	30, 60
NASA001SF	Support Feet, 4" tall	18, 24, 30, 36, 42
NASA001SJ	Sound Jacket, Compressor	18, 24, 30, 36, 42, 48
NASA003SJ	Sound Jacket, Compressor	60
AMF153TKB	TXV Kit, R-22 (converts R-22 piston coils to R-22 TXV)	18, 24, 30, 36
AMF355TKB	TXV Kit, R-22 (converts R-22 piston coils to R-22 TXV)	42, 48, 60

COOLING PERFORMANCE FOR COMBINATION RATINGS
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A318AKA	‡EB*2X18B**		TXV	17,000	0.74	11.00		13.00
	EB*2X18B**	*8MPV050	TDR&TXV	17,000	0.74	12.00	14.00	
	EB*2X18B**	MV08B15****	TDR&TXV	17,000	0.74	12.00	14.00	
	EB*2X24B**		TXV	17,500	0.74	11.00		13.00
	EB*2X24B**	*8MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	EB*2X24B**	MV08B15****	TDR&TXV	17,500	0.74	12.00	14.00	
	EB*2X24F**		TXV	17,500	0.74	11.00		13.00
	EB*2X24F**	*9MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	EB*2X24F**	*9MPV075	TDR&TXV	17,500	0.74	12.00	14.00	
	EB*2X24F**	MV12F19****	TDR&TXV	17,500	0.74	12.00	14.00	
	ED*2X18B**		TXV	17,000	0.74	11.00		13.00
	ED*2X18B**	*8MPV050	TDR&TXV	17,000	0.74	12.00	14.00	
	ED*2X18B**	MV08B15****	TDR&TXV	17,000	0.74	12.00	14.00	
	ED*2X24B**		TXV	17,500	0.74	11.00		13.00
	ED*2X24B**	*8MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	ED*2X24B**	MV08B15****	TDR&TXV	17,500	0.74	12.00	14.00	
	ED*2X24F**		TXV	17,500	0.74	11.00		13.00
	ED*2X24F**	*9MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	ED*2X24F**	*9MPV075	TDR&TXV	17,500	0.74	12.00	14.00	
	ED*2X24F**	MV12F19****	TDR&TXV	17,500	0.74	12.00	14.00	
	EMA2X24D**		TXV	17,500	0.74	11.00		13.00
	EHD2X24A**		TXV	17,500	0.74	11.00		13.00
	EHD2X24A**	*8MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	EHD2X24A**	*9MPV050	TDR&TXV	17,500	0.74	12.00	14.00	
	EHD2X24A**	*9MPV075	TDR&TXV	17,500	0.74	12.00	14.00	
	EHD2X24A**	MV08B15****	TDR&TXV	17,500	0.74	12.00	14.00	
	EHD2X24A**	MV12F19****	TDR&TXV	17,500	0.74	12.00	14.00	
	FS(M,U)2X18****		TDR&TXV	17,000	0.74	11.00	13.00	
	FS(M,U)2X24****		TDR&TXV	17,500	0.74	11.00	13.00	
	FEM2X18****		TDR&TXV	17,000	0.74	12.00	14.00	
FEM2X24****		TDR&TXV	17,500	0.74	12.00	14.00		
FVM2X24****		TDR&TXV	17,500	0.74	12.00	14.00		
FSA2X18****		TDR&TXV	17,000	0.74	11.00	13.00		
FSA2X24****		TDR&TXV	17,500	0.74	11.00	13.00		
R2A324AKA	‡EB*2X24B**		TXV	23,000	0.72	11.00		13.00
	EB*2X24B**	*8MPV050	TDR&TXV	23,000	1.72	12.00	14.00	
	EB*2X24B**	MV08B15****	TDR&TXV	23,000	2.72	12.00	14.00	
	EB*2X24F**		TXV	23,000	3.72	11.00		13.00
	EB*2X24F**	*8MPV075	TDR&TXV	23,000	4.72	12.00	14.00	
	EB*2X24F**	*9MPV050	TDR&TXV	23,000	5.72	12.00	14.00	
	EB*2X24F**	*9MPV075	TDR&TXV	23,000	6.72	12.00	14.00	
	EB*2X24F**	MV12F19****	TDR&TXV	23,000	7.72	12.00	14.00	
	EB*2X30B**		TXV	23,400	8.72	11.00		13.00
	EB*2X30B**	*8MPV050	TDR&TXV	23,400	9.72	12.00	14.00	
	EB*2X30B**	MV08B15****	TDR&TXV	23,400	10.72	12.00	14.00	
	EB*2X30F**		TXV	23,400	11.72	11.00		13.00
	EB*2X30F**	*8MPV075	TDR&TXV	23,400	12.72	12.00	14.00	
	EB*2X30F**	*9MPV050	TDR&TXV	23,400	13.72	12.00	14.00	
	EB*2X30F**	*9MPV075	TDR&TXV	23,400	14.72	12.00	14.00	
	EB*2X30F**	MV12F19****	TDR&TXV	23,400	15.72	12.00	14.00	
	ED*2X24B**		TXV	23,000	16.72	11.00		13.00
	ED*2X24B**	*8MPV050	TDR&TXV	23,000	17.72	12.00	14.00	
	ED*2X24B**	MV08B15****	TDR&TXV	23,000	18.72	12.00	14.00	
	ED*2X24F**		TXV	23,000	19.72	11.00		13.00
	ED*2X24F**	*8MPV075	TDR&TXV	23,000	20.72	12.00	14.00	
	ED*2X24F**	*9MPV050	TDR&TXV	23,000	21.72	12.00	14.00	
	ED*2X24F**	*9MPV075	TDR&TXV	23,000	22.72	12.00	14.00	
	ED*2X24F**	MV12F19****	TDR&TXV	23,000	23.72	12.00	14.00	
	ED*2X30B**		TXV	23,400	24.72	11.00		13.00
	ED*2X30B**	*8MPV050	TDR&TXV	23,400	25.72	12.00	14.00	

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Current Indoor Models								
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A324AKA (continued)	ED*2X30B**	MV08B15****	TDR&TXV	23,400	26.72	12.00	14.00	
	ED*2X30F**		TXV	23,400	27.72	11.00		13.00
	ED*2X30F**	*8MPV075	TDR&TXV	23,400	28.72	12.00	14.00	
	ED*2X30F**	*9MPV050	TDR&TXV	23,400	29.72	12.00	14.00	
	ED*2X30F**	*9MPV075	TDR&TXV	23,400	30.72	12.00	14.00	
	ED*2X30F**	MV12F19****	TDR&TXV	23,400	31.72	12.00	14.00	
	EMA2X24D**		TXV	23,000	32.72	11.00		13.00
	EHD2X24A**		TXV	23,000	33.72	11.00		13.00
	EHD2X24A**	*8MPV050	TDR&TXV	23,000	34.72	12.00	14.00	
	EHD2X24A**	*8MPV075	TDR&TXV	23,000	35.72	12.00	14.00	
	EHD2X24A**	*8MPV100	TDR&TXV	23,000	36.72	12.00	14.00	
	EHD2X24A**	*8MPV125	TDR&TXV	23,000	37.72	12.00	14.00	
	EHD2X24A**	*9MPV050	TDR&TXV	23,000	38.72	12.00	14.00	
	EHD2X24A**	*9MPV075	TDR&TXV	23,000	39.72	12.00	14.00	
	EHD2X24A**	*9MPV100	TDR&TXV	23,000	40.72	12.00	14.00	
	EHD2X24A**	*9MPV125	TDR&TXV	23,000	41.72	12.00	14.00	
	EHD2X24A**	MV08B15****	TDR&TXV	23,000	42.72	12.00	14.00	
	EHD2X24A**	MV12F19****	TDR&TXV	23,000	43.72	12.00	14.00	
	EHD2X24A**	MV16J22****	TDR&TXV	23,000	44.72	12.00	14.00	
	EHD2X24A**	MV20N26****	TDR&TXV	23,000	45.72	12.00	14.00	
	EHD2X30A**		TXV	23,400	46.72	11.00		13.00
	EHD2X30A**	*8MPV050	TDR&TXV	23,400	47.72	12.00	14.00	
	EHD2X30A**	*8MPV075	TDR&TXV	23,400	48.72	12.00	14.00	
	EHD2X30A**	*8MPV100	TDR&TXV	23,400	49.72	12.00	14.00	
	EHD2X30A**	*8MPV125	TDR&TXV	23,400	50.72	12.00	14.00	
	EHD2X30A**	*9MPV050	TDR&TXV	23,400	51.72	12.00	14.00	
	EHD2X30A**	*9MPV075	TDR&TXV	23,400	52.72	12.00	14.00	
	EHD2X30A**	*9MPV100	TDR&TXV	23,400	53.72	12.00	14.00	
	EHD2X30A**	*9MPV125	TDR&TXV	23,400	54.72	12.00	14.00	
	EHD2X30A**	MV08B15****	TDR&TXV	23,400	55.72	12.00	14.00	
	EHD2X30A**	MV12F19****	TDR&TXV	23,400	56.72	12.00	14.00	
	EHD2X30A**	MV16J22****	TDR&TXV	23,400	57.72	12.00	14.00	
	EHD2X30A**	MV20N26****	TDR&TXV	23,400	58.72	12.00	14.00	
	FS(M,U)2X24****		TDR&TXV	23,000	59.72	11.00		13.00
	FS(M,U)2X30****		TDR&TXV	23,400	60.72	11.00		13.00
	FEM2X24****		TDR&TXV	23,000	61.72	12.00	14.00	
FEM2X30****		TDR&TXV	23,400	62.72	12.00	14.00		
FVM2X24****		TDR&TXV	23,000	63.72	12.00	14.00		
FVM2X36****		TDR&TXV	23,400	64.72	12.00	14.00		
FSA2X24****		TDR&TXV	23,000	65.72	11.00		13.00	
FSA2X30****		TDR&TXV	23,200	66.72	11.00		13.00	
R2A330AKA	‡EB*2X30B**		TXV	28,000	0.71	11.00		13.00
	EB*2X30B**	*8MPV050	TDR&TXV	28,000	0.71	11.50	13.50	
	EB*2X30B**	MV08B15****	TDR&TXV	28,000	0.71	12.00	14.00	
	EB*2X30F**		TXV	28,000	0.71	11.00		13.00
	EB*2X30F**	*8MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	EB*2X30F**	*9MPV050	TDR&TXV	28,000	0.71	12.00	14.00	
	EB*2X30F**	*9MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	EB*2X30F**	MV12F19****	TDR&TXV	28,000	0.71	12.00	14.00	
	EB*2X36B**		TXV	28,400	0.71	11.00		13.00
	EB*2X36B**	*8MPV050	TDR&TXV	28,400	0.71	11.50	13.50	
	EB*2X36B**	MV08B15****	TDR&TXV	28,400	0.71	12.00	14.00	
	EB*2X36F**		TXV	28,400	0.71	11.00		13.00
	EB*2X36F**	*8MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	EB*2X36F**	*9MPV050	TDR&TXV	28,200	0.71	12.00	14.00	
	EB*2X36F**	*9MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	EB*2X36F**	MV12F19****	TDR&TXV	28,400	0.71	12.00	14.00	
	EB*2X36J**		TXV	28,400	0.71	11.00		13.00
	EB*2X36J**	*8MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
EB*2X36J**	*8MPV125	TDR&TXV	28,400	0.71	12.00	14.00		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Current Indoor Models								
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A330AKA (continued)	EB*2X36J**	*9MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
	EB*2X36J**	MV16J22****	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X30B**		TXV	28,000	0.71	11.00		13.00
	ED*2X30B**	*8MPV050	TDR&TXV	28,000	0.71	11.50	13.50	
	ED*2X30B**	MV08B15****	TDR&TXV	28,000	0.71	12.00	14.00	
	ED*2X30F**		TXV	28,000	0.71	11.00		13.00
	ED*2X30F**	*8MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	ED*2X30F**	*9MPV050	TDR&TXV	28,000	0.71	12.00	14.00	
	ED*2X30F**	*9MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	ED*2X30F**	MV12F19****	TDR&TXV	28,000	0.71	12.00	14.00	
	ED*2X36B**		TXV	28,400	0.71	11.00		13.00
	ED*2X36B**	*8MPV050	TDR&TXV	28,400	0.71	11.50	13.50	
	ED*2X36B**	MV08B15****	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36F**		TXV	28,400	0.71	11.00		13.00
	ED*2X36F**	*8MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36F**	*9MPV050	TDR&TXV	28,200	0.71	12.00	14.00	
	ED*2X36F**	*9MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36F**	MV12F19****	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36J**		TXV	28,400	0.71	11.00		13.00
	ED*2X36J**	*8MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36J**	*8MPV125	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36J**	*9MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
	ED*2X36J**	MV16J22****	TDR&TXV	28,400	0.71	12.00	14.00	
	EMA2X36D**		TXV	28,200	0.71	11.00		13.00
	EHD2X30A**		TXV	28,000	0.71	11.00		13.00
	EHD2X30A**	*8MPV050	TDR&TXV	28,000	0.71	11.50	13.50	
	EHD2X30A**	*8MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*8MPV100	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*8MPV125	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*9MPV050	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*9MPV075	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*9MPV100	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	*9MPV125	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	MV08B15****	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	MV12F19****	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	MV16J22****	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X30A**	MV20N26****	TDR&TXV	28,000	0.71	12.00	14.00	
	EHD2X36A**		TXV	28,400	0.71	11.00		13.00
	EHD2X36A**	*8MPV050	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*8MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*8MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*8MPV125	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*9MPV050	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*9MPV075	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*9MPV100	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	*9MPV125	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	MV08B15****	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	MV12F19****	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	MV16J22****	TDR&TXV	28,400	0.71	12.00	14.00	
	EHD2X36A**	MV20N26****	TDR&TXV	28,400	0.71	12.00	14.00	
FS(M,U)2X30****		TDR&TXV	28,000	0.71	11.00	13.00		
FSU2X36****		TDR&TXV	28,200	0.71	11.00	13.00		
FEM2X30****		TDR&TXV	28,000	0.71	12.00	14.00		
FEM2X35****		TDR&TXV	28,400	0.71	12.00	14.00		
FSM2X36****		TDR&TXV	28,400	0.71	11.00	13.00		
FEM2X36****		TDR&TXV	28,400	0.71	12.00	14.00		
FVM2X36****		TDR&TXV	28,400	0.71	12.00	14.00		
FVM2X48****		TDR&TXV	28,800	0.71	12.00	14.00		
FSA2X30****		TDR&TXV	28,000	0.71	11.00	13.00		
FSA2X36****		TDR&TXV	28,400	0.71	11.00	13.00		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Current Indoor Models								
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A336AKA	‡EB*2X36F**		TXV	34,000	0.74	11.00		13.00
	EB*2X36B**		TXV	34,000	0.74	11.00		13.00
	EB*2X36B**	*8MPV050	TDR&TXV	34,000	0.74	11.50	13.50	
	EB*2X36B**	MV08B15****	TDR&TXV	34,000	0.74	11.50	13.50	
	EB*2X36F**	*8MPV075	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X36F**	*9MPV050	TDR&TXV	34,000	0.74	11.50	13.50	
	EB*2X36F**	*9MPV075	TDR&TXV	34,000	0.74	11.50	13.50	
	EB*2X36F**	MV12F19****	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X36J**		TXV	34,000	0.74	11.00		13.00
	EB*2X36J**	*8MPV100	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X36J**	*8MPV125	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X36J**	*9MPV100	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X36J**	MV16J22****	TDR&TXV	34,000	0.74	12.00	14.00	
	EB*2X42J**		TXV	34,400	0.74	11.00		13.00
	EB*2X42J**	*8MPV100	TDR&TXV	34,400	0.74	12.00	14.00	
	EB*2X42J**	*8MPV125	TDR&TXV	34,400	0.74	12.00	14.00	
	EB*2X42J**	*9MPV100	TDR&TXV	34,400	0.74	12.00	14.00	
	EB*2X42J**	MV16J22****	TDR&TXV	34,400	0.74	12.00	14.00	
	EB*2X42L**		TXV	34,400	0.74	11.00		13.00
	EB*2X42L**	*9MPV125	TDR&TXV	34,400	0.74	12.00	14.00	
	ED*2X36B**		TXV	34,000	0.74	11.00		13.00
	ED*2X36B**	*8MPV050	TDR&TXV	34,000	0.74	11.50	13.50	
	ED*2X36B**	MV08B15****	TDR&TXV	34,000	0.74	11.50	13.50	
	ED*2X36F**		TXV	34,000	0.74	11.00	13.00	
	ED*2X36F**	*8MPV075	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X36F**	*9MPV050	TDR&TXV	34,000	0.74	11.50	13.50	
	ED*2X36F**	*9MPV075	TDR&TXV	34,000	0.74	11.50	13.50	
	ED*2X36F**	MV12F19****	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X36J**		TXV	34,000	0.74	11.00		13.00
	ED*2X36J**	*8MPV100	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X36J**	*8MPV125	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X36J**	*9MPV100	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X36J**	MV16J22****	TDR&TXV	34,000	0.74	12.00	14.00	
	ED*2X42J**		TXV	34,400	0.74	11.00		13.00
	ED*2X42J**	*8MPV100	TDR&TXV	34,400	0.74	12.00	14.00	
	ED*2X42J**	*8MPV125	TDR&TXV	34,400	0.74	12.00	14.00	
	ED*2X42J**	*9MPV100	TDR&TXV	34,400	0.74	12.00	14.00	
	ED*2X42J**	MV16J22****	TDR&TXV	34,400	0.74	12.00	14.00	
	ED*2X42L**		TXV	34,400	0.74	11.00		13.00
	ED*2X42L**	*9MPV125	TDR&TXV	34,400	0.74	12.00	14.00	
	EMA2X36D**		TXV	34,000	0.74	11.00		13.00
	EHD2X36A**		TXV	34,000	0.74	11.00		13.00
EHD2X36A**	*8MPV050	TDR&TXV	34,000	0.74	11.50	13.50		
EHD2X36A**	*8MPV075	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	*8MPV100	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	*8MPV125	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	*9MPV050	TDR&TXV	34,000	0.74	11.50	13.50		
EHD2X36A**	*9MPV075	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	*9MPV100	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	*9MPV125	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	MV08B15****	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	MV12F19****	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	MV16J22****	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X36A**	MV20N26****	TDR&TXV	34,000	0.74	12.00	14.00		
EHD2X42A**		TXV	34,400	0.74	11.00		13.00	
EHD2X42A**	*8MPV050	TDR&TXV	34,400	0.74	11.50	13.50		
EHD2X42A**	*8MPV075	TDR&TXV	34,400	0.74	12.00	14.00		
EHD2X42A**	*8MPV100	TDR&TXV	34,400	0.74	12.00	14.00		
EHD2X42A**	*8MPV125	TDR&TXV	34,400	0.74	12.00	14.00		
EHD2X42A**	*9MPV050	TDR&TXV	34,400	0.74	12.00	14.00		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Current Indoor Models								
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A336AKA (continued)	EHD2X42A**	*9MPV075	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	*9MPV100	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	*9MPV125	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	MV08B15****	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	MV12F19****	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	MV16J22****	TDR&TXV	34,400	0.74	12.00	14.00	
	EHD2X42A**	MV20N26****	TDR&TXV	34,400	0.74	12.00	14.00	
	FSU2X36****		TDR&TXV	34,000	0.74	11.00	13.00	
	FS(M,U)2X42****		TDR&TXV	34,400	0.74	11.00	13.00	
	FEM2X35****		TDR&TXV	34,000	0.74	12.00	14.00	
	FSM2X36****		TDR&TXV	34,000	0.74	11.00	13.00	
	FEM2X36****		TDR&TXV	34,000	0.74	12.00	14.00	
	FEM2X42****		TDR&TXV	34,400	0.74	12.00	14.00	
	FVM2X24****		TDR&TXV	34,000	0.74	12.00	14.00	
	FVM2X36****		TDR&TXV	34,000	0.74	12.00	14.00	
	FVM2X48****		TDR&TXV	34,800	0.74	12.00	14.00	
	FVM2X60****		TDR&TXV	35,000	0.74	12.00	14.00	
	FSA2X36****		TDR&TXV	34,000	0.74	11.00	13.00	
R2A342AKA	‡EB*2X42J**		TXV	40,000	0.72	11.00		13.00
	EB*2X42J**	*8MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	EB*2X42J**	*8MPV125	TDR&TXV	40,000	0.72	12.00	14.00	
	EB*2X42J**	*9MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	EB*2X42J**	MV16J22****	TDR&TXV	40,000	0.72	12.00	14.00	
	EB*2X42L**		TXV	40,000	0.72	11.00		13.00
	EB*2X42L**	*9MPV125	TDR&TXV	40,000	0.72	12.00	14.00	
	EB*2X48F**		TXV	40,500	0.72	11.00		13.00
	EB*2X48F**	*8MPV075	TDR&TXV	40,500	0.72	12.00	14.00	
	EB*2X48F**	*9MPV075	TDR&TXV	40,500	0.72	11.50	13.50	
	EB*2X48J**		TXV	40,500	0.72	11.00		13.00
	EB*2X48J**	*8MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	EB*2X48J**	*8MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	EB*2X48J**	*9MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	EB*2X48J**	MV16J22****	TDR&TXV	40,500	0.72	12.00	14.00	
	EB*2X48L**		TXV	40,500	0.72	11.00		13.00
	EB*2X48L**	*9MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X42J**		TXV	40,000	0.72	11.00		13.00
	ED*2X42J**	*8MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	ED*2X42J**	*8MPV125	TDR&TXV	40,000	0.72	12.00	14.00	
	ED*2X42J**	*9MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	ED*2X42J**	MV16J22****	TDR&TXV	40,000	0.72	12.00	14.00	
	ED*2X42L**		TXV	40,000	0.72	11.00		13.00
	ED*2X42L**	*9MPV125	TDR&TXV	40,000	0.72	12.00	14.00	
	ED*2X48F**		TXV	40,500	0.72	11.00		13.00
	ED*2X48F**	*8MPV075	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X48F**	*9MPV075	TDR&TXV	40,500	0.72	11.50	13.50	
	ED*2X48J**		TXV	40,500	0.72	11.00		13.00
	ED*2X48J**	*8MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X48J**	*8MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X48J**	*9MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X48J**	MV16J22****	TDR&TXV	40,500	0.72	12.00	14.00	
	ED*2X48L**		TXV	40,500	0.72	11.00		13.00
	ED*2X48L**	*9MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	EMA2X48D**		TXV	40,500	0.72	11.00		13.00
	EHD2X42A**		TXV	40,000	0.72	11.00		13.00
	EHD2X42A**	*8MPV075	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X42A**	*8MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X42A**	*8MPV125	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X42A**	*9MPV075	TDR&TXV	40,000	0.72	11.50	13.50	
	EHD2X42A**	*9MPV100	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X42A**	*9MPV125	TDR&TXV	40,000	0.72	12.00	14.00	

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)								
Current Indoor Models								
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER	
				BTU/hr	S/T	EER	factory	w/ field TDR
R2A342AKA (continued)	EHD2X42A**	MV16J22****	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X42A**	MV20N26****	TDR&TXV	40,000	0.72	12.00	14.00	
	EHD2X48A**		TXV	40,500	0.72	11.00		13.00
	EHD2X48A**	*8MPV075	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	*8MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	*8MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	*9MPV075	TDR&TXV	40,500	0.72	11.50	13.50	
	EHD2X48A**	*9MPV100	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	*9MPV125	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	MV16J22****	TDR&TXV	40,500	0.72	12.00	14.00	
	EHD2X48A**	MV20N26****	TDR&TXV	40,500	0.72	12.00	14.00	
	FS(M,U)2X42****		TDR&TXV	40,000	0.72	11.00	13.00	
	FS(M,U)2X48****		TDR&TXV	40,500	0.72	11.00	13.00	
	FEM2X42****		TDR&TXV	40,000	0.72	12.00	14.00	
	FEM2X48****		TDR&TXV	40,500	0.72	12.00	14.00	
	FVM2X36****		TDR&TXV	40,000	0.72	12.00	14.00	
FVM2X48****		TDR&TXV	40,500	0.72	12.00	14.00		
FVM2X60****		TDR&TXV	41,000	0.72	12.00	14.00		
R2A348AKA	‡EB*2X48J**		TXV	46,000	0.75	11.00		13.00
	EB*2X48F**		TXV	46,000	0.75	11.00		13.00
	EB*2X48J**	*8MPV100	TDR&TXV	46,000	0.75	11.50	13.50	
	EB*2X48J**	*8MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	EB*2X48J**	*9MPV100	TDR&TXV	46,000	0.75	11.00	13.00	
	EB*2X48J**	MV16J22****	TDR&TXV	46,000	0.75	12.00	14.00	
	EB*2X48L**		TXV	46,000	0.75	11.00		13.00
	EB*2X48L**	*9MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	EB*2X60J**		TXV	47,000	0.75	11.00		13.00
	EB*2X60J**	*8MPV100	TDR&TXV	47,000	0.75	12.00	14.00	
	EB*2X60J**	*8MPV125	TDR&TXV	47,000	0.75	12.00	14.00	
	EB*2X60J**	*9MPV100	TDR&TXV	47,000	0.75	11.50	13.50	
	EB*2X60J**	MV16J22****	TDR&TXV	47,000	0.75	12.00	14.00	
	EB*2X60L**		TXV	47,000	0.75	11.00		13.00
	EB*2X60L**	*9MPV125	TDR&TXV	47,000	0.75	11.50	13.50	
	ED*2X48F**		TXV	46,000	0.75	11.00		13.00
	ED*2X48J**		TXV	46,000	0.75	11.00		13.00
	ED*2X48J**	*8MPV100	TDR&TXV	46,000	0.75	11.50	13.50	
	ED*2X48J**	*8MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	ED*2X48J**	*9MPV100	TDR&TXV	46,000	0.75	11.00	13.00	
	ED*2X48J**	MV16J22****	TDR&TXV	46,000	0.75	12.00	14.00	
	ED*2X48L**		TXV	46,000	0.75	11.00		13.00
	ED*2X48L**	*9MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	ED*2X60J**		TXV	47,000	0.75	11.00		13.00
	ED*2X60J**	*8MPV100	TDR&TXV	47,000	0.75	12.00	14.00	
	ED*2X60J**	*8MPV125	TDR&TXV	47,000	0.75	12.00	14.00	
	ED*2X60J**	*9MPV100	TDR&TXV	47,000	0.75	11.50	13.50	
	ED*2X60J**	MV16J22****	TDR&TXV	47,000	0.75	12.00	14.00	
	ED*2X60L**		TXV	47,000	0.75	11.00		13.00
	ED*2X60L**	*9MPV125	TDR&TXV	47,000	0.75	11.50	13.50	
	EMA2X48D**		TXV	46,000	0.75	11.00		13.00
	EHD2X48A**		TXV	46,000	0.75	11.00		13.00
	EHD2X48A**	*8MPV100	TDR&TXV	46,000	0.75	11.50	13.50	
	EHD2X48A**	*8MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	EHD2X48A**	*9MPV100	TDR&TXV	46,000	0.75	11.00	13.00	
	EHD2X48A**	*9MPV125	TDR&TXV	46,000	0.75	11.50	13.50	
	EHD2X48A**	MV16J22****	TDR&TXV	46,000	0.75	12.00	14.00	
	EHD2X48A**	MV20N26****	TDR&TXV	46,000	0.75	12.00	14.00	
	EHD2X60A**		TXV	47,000	0.75	11.00		13.00
	EHD2X60A**	*8MPV100	TDR&TXV	47,000	0.75	12.00	14.00	
EHD2X60A**	*8MPV125	TDR&TXV	47,000	0.75	12.00	14.00		
EHD2X60A**	*9MPV100	TDR&TXV	47,000	0.75	11.50	13.50		

- continued on next page -

COOLING PERFORMANCE FOR COMBINATION RATINGS (continued)									
Current Indoor Models									
Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cooling (95° F)			SEER		
				BTU/hr	S/T	EER	factory	w/ field TDR	
R2A348AKA (continued)	EHD2X60A**	*9MPV125	TDR&TXV	47,000	0.75	11.50	13.50		
	EHD2X60A**	MV16J22****	TDR&TXV	47,000	0.75	12.00	14.00		
	EHD2X60A**	MV20N26****	TDR&TXV	47,000	0.75	12.00	14.00		
	FS(M,U)2X48****		TDR&TXV	46,000	0.75	11.00	13.00		
	FS(M,U)2X60****		TDR&TXV	47,000	0.75	11.00	13.00		
	FEM2X48****		TDR&TXV	46,000	0.75	12.00	14.00		
	FEM2X60****		TDR&TXV	47,000	0.75	12.00	14.00		
	FVM2X48****		TDR&TXV	46,000	0.75	12.00	14.00		
	FVM2X60****		TDR&TXV	47,000	0.75	12.00	14.00		
R2A360AKA	‡EB*2X60L**		TXV	57,000	0.74	11.00		13.00	
	EB*2X60J**		TXV	57,000	0.74	11.00		13.00	
	EB*2X60J**	*8MPV100	TDR&TXV	57,000	0.74	11.00	13.00		
	EB*2X60J**	*8MPV125	TDR&TXV	57,000	0.74	11.00	13.00		
	EB*2X60J**	MV16J22****	TDR&TXV	57,000	0.74	11.50	13.50		
	ED*2X60J**		TXV	57,000	0.74	11.00		13.00	
	ED*2X60J**	*8MPV100	TDR&TXV	57,000	0.74	11.00	13.00		
	ED*2X60J**	*8MPV125	TDR&TXV	57,000	0.74	11.00	13.00		
	ED*2X60J**	MV16J22****	TDR&TXV	57,000	0.74	11.50	13.50		
	ED*2X60L**		TXV	57,000	0.74	11.00		13.00	
	EHD2X60A**		TXV	57,000	0.74	11.00		13.00	
	EHD2X60A**	*8MPV100	TDR&TXV	57,000	0.74	11.00	13.00		
	EHD2X60A**	*8MPV125	TDR&TXV	57,000	0.74	11.00	13.00		
	EHD2X60A**	*9MPV125	TDR&TXV	57,000	0.74	11.00	13.00		
	EHD2X60A**	MV16J22****	TDR&TXV	57,000	0.74	11.50	13.50		
	EHD2X60A**	MV20N26****	TDR&TXV	57,000	0.74	11.50	13.50		
		FS(M,U)2X60****		TDR&TXV	57,000	0.74	11.00	13.00	
		FEM2X60****		TDR&TXV	57,500	0.74	11.50	13.50	
	FVM2X60****		TDR&TXV	57,500	0.74	11.50	13.50		

OUTDOOR UNIT MODEL NUMBER IDENTIFICATION GUIDE (single phase)											
Digit Position:	1	2	3	4	5, 6	7	8	9	10	11	12
Example Part Number:	R	2	A	3	18	A	K	A	1	0	0
Product Family	REFRIGERANT 2 = R-22 4 = R-410A		TYPE A = Air Conditioner H = Heat Pump								
	NOMINAL EFFICIENCY 3 = 13 SEER 4 = 14 SEER										
	NOMINAL CAPACITY 18 = 18,000 BTUH = 1½ tons 24 = 24,000 BTUH = 2 tons 30 = 30,000 BTUH = 2½ tons 36 = 36,000 BTUH = 3 tons 42 = 42,000 BTUH = 3½ tons 48 = 48,000 BTUH = 4 tons 60 = 60,000 BTUH = 5 tons										
	FEATURES A = Standard Grille G = Coil Guard Grille										
	VOLTAGE K = 208/230-1-60										
Sales Code											
Engineering Revision											
Extra Digit											
Extra Digit											

ACCESSORIES PART NUMBER IDENTIFICATION GUIDE									
Digit Position:	1	2	3	4	5	6, 7	8, 9	10, 11	
Example Part Number:	N	A	S	A	0	01	01	CH	
N = Non-Branded	BRANDING								
A = Accessory	PRODUCT GROUP								
S = Split System (AC & HP)	KIT USAGE								
A = Original B = 2nd Generation	MAJOR SERIES								
0 = Generic or Not Applicable 2 = R-22 4 = R-410A	REFRIGERANT								
Product Identifier Number									
Package Quantity									
Type of Kit (Example: CH = Crankcase Heater)									