

R2H3

Product Specifications

EFFICIENT 13 SEER HEAT PUMP

1½ THRU 5 TONS SPLIT SYSTEM

208 / 230 Volt, 1-phase, 60 Hz

REFRIGERATION CIRCUIT

- Dependable compressors on all models
- Suction line accumulator factory installed
- Integrated solid state control with Time-Temperature Defrost
- Low pressure switch
- Copper tube / aluminum fin coil

EASY TO INSTALL AND SERVICE

- Easy Access service valves on all models
- External high and low refrigerant service ports
- Only two screws to access control panel
- Factory charged with R-22 refrigerant

BUILT TO LAST


- Pre-painted cabinet finish over galvanized steel
- Coated inlet grille with 2" spacing standard
- 5 year limited compressor, coil, and parts warranties



Rated in accordance with ARI Standard 210/240.
Certification applies only when used with proper
components as listed with ARI.



Model Number	Size (tons)	Nominal BTU/hr	Min. Circuit Ampacity	Max. Fuse or Breaker	Operating Dimensions height x width x depth (in)	Shipping/Operating Weight (lbs)
R2H318AKA	1½	18,000	13.8	20	33 ¹⁵ / ₁₆ x 22½ x 22½	123 / 113
R2H324AKA	2	24,000	16.1	25	27 ¹⁵ / ₁₆ x 30 x 30	171 / 156
R2H330AKA	2½	30,000	22.0	30	33 ¹⁵ / ₁₆ x 30 x 30	187 / 171
R2H336AKA	3	36,000	23.4	35	33 ¹⁵ / ₁₆ x 30 x 30	187 / 171
R2H342AKA	3½	42,000	30.1	50	29 ¹⁵ / ₁₆ x 30 x 30	214 / 197
R2H348AKA	4	48,000	31.0	50	33 ¹⁵ / ₁₆ x 30 x 30	255 / 237
R2H360AKA	5	60,000	32.7	50	43 ¹⁵ / ₁₆ x 30 x 30	283 / 264

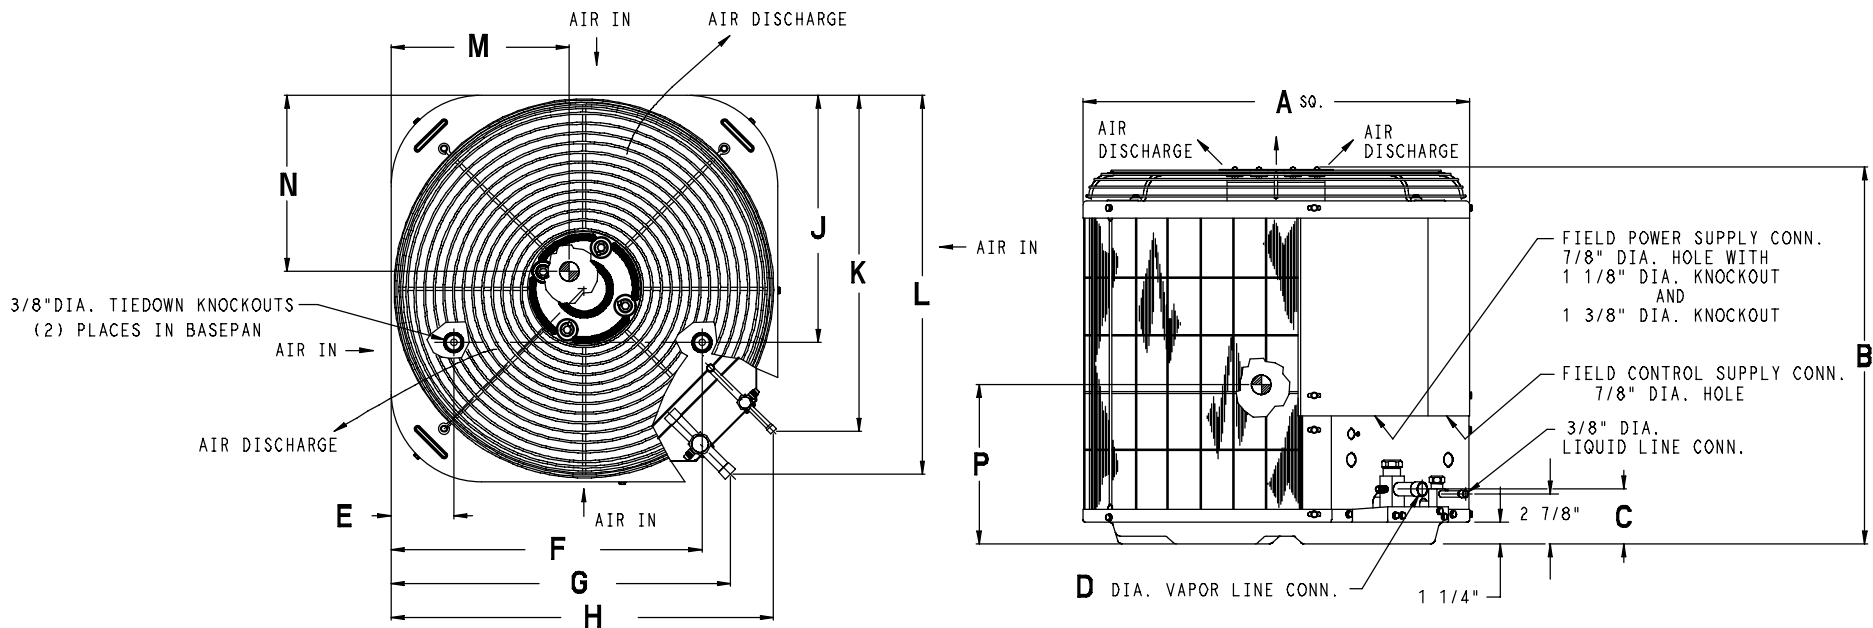

Model	All Dimensions Inches														Minimum Mounting Pad Size	Crated Dimensions B(h) x A(w) x A(d)
	A	B	C	D	E	F	G	H	J	K	L	M	N	P		
R2H318AKA	22½	33 ¹⁵ / ₁₆	3 ³ / ₁₆	5/8	3 ¹¹ / ₁₆	18 ³ / ₈	19¾	21 ⁵ / ₈	14 ³ / ₈	18 ⁷ / ₈	22 ¹ / ₆	10¾	11	14½	22½ x 22½	34 x 23½ x 23½
R2H324AKA	30	27 ¹⁵ / ₁₆	3 ³ / ₁₆	¾	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	11¾	30 x 30	28 x 30½ x 30½
R2H330AKA	30	33 ¹⁵ / ₁₆	3 ³ / ₁₆	¾	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	14½	30 x 30	34 x 30½ x 30½
R2H336AKA	30	33 ¹⁵ / ₁₆	3 ³ / ₁₆	¾	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	14½	30 x 30	34 x 30½ x 30½
R2H342AKA	30	29 ¹⁵ / ₁₆	3¼	7/8	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	14¼	30 x 30	30 x 30½ x 30½
R2H348AKA	30	33 ¹⁵ / ₁₆	3¼	7/8	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	14½	30 x 30	34 x 30½ x 30½
R2H360AKA	30	43 ¹⁵ / ₁₆	3¼	7/8	6½	23½	27¼	29½	20	26 ³ / ₈	29 ⁹ / ₁₆	15½	14	15½	30 x 30	44½ x 30½ x 30½

PHYSICAL DATA							
Model Size	18	24	30	36	42	48	60
Nominal Cooling Capacity (BTU/hr)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Nominal SEER	13.0	13.0	13.0	13.0	13.0	13.0	13.0
Sound Rating (dBA)	76	76	76	76	80	80	80
PSC Fan Motor HP	1/12	1/5	1/5	1/5	1/5	1/5	1/4
Fan RPM (single speed)	1100	825	825	825	825	825	1100
Fan CFM	1700	2800	2800	2800	2800	2800	3400
Coil Face Area (ft ²)	12.42	14.80	18.87	18.87	16.03	18.50	24.66
Coil Rows – fins per inch	1 – 20	1 – 20	1 – 20	1 – 20	2 – 20	2 – 20	2 – 20
Liquid Line Connection Size (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Vapor Line Connection Size (in.)	5/8	5/8	3/4	3/4	7/8	7/8	7/8
Recommended Line Set Liquid Tube Diameter (in.)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Recommended Line Set Vapor Tube Diameter (in.)	5/8 *	5/8 *	3/4 *	3/4 *	7/8 *	7/8 *	1 1/8 *
* Recommended Vapor Tube Line size is for standard installations. These recommendations may not apply to “Long Line” installations. When the total equivalent line length exceeds 80 feet or there is more than 20 feet vertical separation between indoor and outdoor units, consult the Long Line Application Guideline document before purchasing/installing line sets.							
Factory Charge R-22 (lbs.)	5.50	6.25	6.88	8.00	10.38	11.13	18.19
Required Subcooling (°F)	10	10	10	10	10	10	10
Weight, shipping (lbs.)	123	171	187	187	214	255	283
Weight, operating (lbs.)	113	156	171	171	197	237	264

ELECTRICAL DATA (208/230-1-60, voltage range 197V – 253V)							
Model Size	18	24	30	36	42	48	60
Minimum Circuit Ampacity – MCA (amps)	13.8	16.1	22.0	23.4	30.1	31.0	32.7
Maximum OverCurrent Protective device – MOCP (amps)	20	25	30	35	50	50	50
Compressor RLA (Rated Load Amps) LRA (Locked Rotor Amps)	10.6 45.0	12.0 54.0	16.7 72.5	17.8 88.0	23.2 104.0	23.9 137.0	25.0 150.0
Fan Motor FLA (Full Load Amps)	0.5	1.1	1.1	1.1	1.1	1.1	1.4

R-22 COOLING CAPACITY LOSS FOR VARIOUS LINE LENGTHS & TUBE DIAMETERS															
Model Size	Liquid Line (in.)	Acceptable Vapor Line Sizes (in.)	Cooling Capacity Loss (%) at Total Equivalent Line Length (ft.) Refer to Long Line Application Guideline to calculate equivalent length												
			Standard Application			Long Line Application (Requires Accessories)									
			25'	50'	80'	81'	100'	125'	150'	175'	200'	225'	250'		
18	3/8	5/8	0	1	1	1	2	3	3	4	5	5	6		
		3/4	0	0	0	0	0	1	1	1	1	2	2		
24		5/8	0	1	3	3	3	5	6	7	8	9	10		
		3/4	0	0	0	0	1	1	1	2	2	3	3		
30		3/4	0	1	1	1	2	3	3	4	5	5	6		
		7/8	0	0	0	0	1	1	1	2	2	2	3		
36		3/4	0	1	2	2	3	4	5	6	7	8	9		
		7/8	0	0	1	1	1	2	2	3	3	4	4		
42		3/4	1	2	3	3	4	5	7	8	9	10	11		
		7/8	0	1	1	1	2	2	3	4	4	5	5		
48		3/4	1	2	4	4	5	7	8	10	11	13	14		
		7/8	0	1	2	2	2	3	4	5	5	6	7		
	1 1/8	0	0	0	0	0	0	1	1	1	1	1			
60	7/8	1	2	3	3	4	5	7	8	9	10	11			
	1 1/8	0	0	1	1	1	1	2	2	2	3	3			

* Applications are considered “Long Line” if the total equivalent tubing length exceeds 80 feet or there is more than 20 foot vertical separation between indoor and outdoor units). These applications require additional accessories and system modifications for reliable system operation.

Applications in shaded area may have height restrictions that limit allowable total equivalent length when outdoor unit is below indoor unit.

ACCESSORY USAGE GUIDELINES			
Accessory	REQUIRED FOR APPLICATIONS IN SNOW-BELT REGION	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55° F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 80 Ft.)
Crankcase Heater	Standard (if required)	Yes	Yes
Evaporator Freeze Thermostat	No	Yes	No
Accumulator	Standard (factory installed)	Standard (factory installed)	Standard (factory installed)
Hard Start Kit (Capacitor & Relay)	No	Yes	Yes
Low Ambient Kit (Pressure Switch)	No	Yes	No
Support Feet, 4” tall	Yes	Recommended	No
Liquid Line Solenoid Valve	No	No	See Long-Line Application Guideline

* For Line Set lengths between 80 and 200 ft horizontal. or more than 20 ft indoor-outdoor vertical separation, refer to the Long Line Application Guideline document.

ACCESSORIES		
Part Number	Description	Used On Model Size
NASA001SC	Start Component – PTC Device	ALL
NASA001FS	Evaporator Freeze Thermostat	ALL
NASA001LS	Liquid Line Solenoid Valve	ALL
NASA001TD	Time Delay Relay, Indoor Blower	ALL
NASA001AC	Anti–Cycle Timer (5 minute delay)	ALL
NASA201LA	Low Ambient Kit (Pressure Switch)	ALL
AMF002OTA	Outdoor Thermometer Kit	ALL
NASA003CH	Crankcase Heater for Compressor	18, 24
NASA001CH	Crankcase Heater for Compressor	30, 36, 60, 42, 48
NASA202PS	High Pressure Switch	18, 24, 30, 36, 60
AXWR01DFC	Fossil Fuel Kit	18, 24, 30, 36, 60
NASA003SC	Hard Start Kit (Capacitor & Relay)	18, 24, 30, 36, 42, 48
NASA004SC	Hard Start Kit (Capacitor & Relay)	60
NASA001SF	Support Feet, 4” tall	18, 24, 36, 60
NASA002SJ	Sound Jacket, Compressor	18, 24, 30
NASA001SJ	Sound Jacket, Compressor	36, 42
NASA003SJ	Sound Jacket, Compressor	48, 60
AMF153TKB	TXV Kit, R–22 (converts R–22 piston coils to R–22 TXV)	18, 24, 30, 36
AMF355TKB	TXV Kit, R–22 (converts R–22 piston coils to R–22 TXV)	42, 48, 60

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER	factory	BTU/hr	COP	BTU/hr	COP	
R2H318AKA	‡FEM2X18****		TDR&TXV	17,500	0.79	11.00	13.00	17,500	3.44	10,900	2.38	7.8
	EB*2X18B**	*8MPV050	TDR&TXV	17,500	0.79	11.00	13.00	17,500	3.30	10,800	2.38	7.7
	EB*2X18B**	MV08B15****	TDR&TXV	17,500	0.79	11.00	13.00	17,400	3.32	10,600	2.38	7.8
	EB*2X24B**	*8MPV050	TDR&TXV	18,000	0.79	11.00	13.00	17,900	3.48	10,900	2.44	8.0
	EB*2X24B**	MV08B15****	TDR&TXV	18,000	0.79	11.00	13.00	17,500	3.50	10,700	2.44	8.0
	EB*2X24F**	*9MPV050	TDR&TXV	18,000	0.79	11.00	13.00	17,900	3.50	10,900	2.46	8.0
	EB*2X24F**	*9MPV075	TDR&TXV	18,000	0.79	11.00	13.00	17,900	3.50	11,000	2.46	8.0
	EB*2X24F**	MV12F19****	TDR&TXV	18,000	0.79	11.00	13.00	17,500	3.52	10,700	2.46	8.0
	ED*2X18B**	*8MPV050	TDR&TXV	17,500	0.79	11.00	13.00	17,500	3.30	10,800	2.38	7.7
	ED*2X18B**	MV08B15****	TDR&TXV	17,500	0.79	11.00	13.00	17,400	3.32	10,600	2.38	7.8
	ED*2X24B**	*8MPV050	TDR&TXV	18,000	0.79	11.00	13.00	17,900	3.48	10,900	2.44	8.0
	ED*2X24B**	MV08B15****	TDR&TXV	18,000	0.79	11.00	13.00	17,600	3.50	10,700	2.44	8.0
	ED*2X24F**	*9MPV050	TDR&TXV	18,000	0.79	11.00	13.00	17,900	3.50	10,900	2.46	8.0
	ED*2X24F**	*9MPV075	TDR&TXV	18,000	0.79	11.00	13.00	17,600	3.42	10,600	2.38	7.8
	ED*2X24F**	MV12F19****	TDR&TXV	18,000	0.79	11.00	13.00	17,600	3.52	10,700	2.46	8.0
	FEM2X24****		TDR&TXV	18,000	0.79	11.00	13.00	18,000	3.34	11,000	2.34	7.8
	FVM2X24****		TDR&TXV	18,000	0.79	11.00	13.00	17,600	3.54	10,600	2.42	8.0
R2H324AKA	‡FEM2X24****		TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.50	13,700	2.34	8.0
	EB*2X24B**	*8MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.52	13,700	2.36	8.0
	EB*2X24B**	MV08B15****	TDR&TXV	23,600	0.79	11.00	13.00	23,000	3.60	13,400	2.40	8.0
	EB*2X24F**	*8MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.62	13,500	2.40	8.0
	EB*2X24F**	*9MPV050	TDR&TXV	23,400	0.79	11.00	13.00	23,200	3.50	13,500	2.36	8.0
	EB*2X24F**	*9MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.52	13,500	2.36	8.0
	EB*2X24F**	MV12F19****	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.66	13,400	2.44	8.0
	EB*2X30B**	*8MPV050	TDR&TXV	23,800	0.79	11.00	13.00	23,400	3.52	13,700	2.38	8.0
	EB*2X30B**	MV08B15****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.60	13,400	2.44	8.0
	EB*2X30F**	*8MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.64	13,600	2.44	8.0
	EB*2X30F**	*9MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.52	13,500	2.38	8.0
	EB*2X30F**	*9MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.54	13,600	2.38	8.0
	EB*2X30F**	MV12F19****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.68	13,400	2.46	8.0
	ED*2X24B**	*8MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.52	13,700	2.36	8.0
	ED*2X24B**	MV08B15****	TDR&TXV	23,600	0.79	11.00	13.00	23,000	3.60	13,400	2.40	8.0
	ED*2X24F**	*8MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.62	13,500	2.40	8.0
	ED*2X24F**	*9MPV050	TDR&TXV	23,400	0.79	11.00	13.00	23,200	3.50	13,500	2.36	8.0
	ED*2X24F**	*9MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.52	13,500	2.36	8.0
	ED*2X24F**	MV12F19****	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.66	13,400	2.44	8.0
	ED*2X30B**	*8MPV050	TDR&TXV	23,800	0.79	11.00	13.00	23,400	3.52	13,700	2.38	8.0
	ED*2X30B**	MV08B15****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.60	13,400	2.44	8.0
ED*2X30F**	*8MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.64	13,600	2.44	8.0	

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER factory	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER		BTU/hr	COP	BTU/hr	COP	
R2H324AKA (continued)	ED*2X30F**	*9MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.52	13,500	2.38	8.0
	ED*2X30F**	*9MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.54	13,600	2.38	8.0
	ED*2X30F**	MV12F19****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.68	13,400	2.46	8.0
	EHD2X24A**	*8MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.56	13,700	2.36	8.0
	EHD2X24A**	*8MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.60	13,500	2.38	8.0
	EHD2X24A**	*8MPV100	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.68	13,600	2.42	8.0
	EHD2X24A**	*8MPV125	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.68	13,500	2.42	8.0
	EHD2X24A**	*9MPV050	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.50	13,500	2.34	8.0
	EHD2X24A**	*9MPV075	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.50	13,500	2.34	8.0
	EHD2X24A**	*9MPV100	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.60	13,600	2.38	8.0
	EHD2X24A**	*9MPV125	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.62	13,600	2.40	8.0
	EHD2X24A**	MV08B15****	TDR&TXV	23,600	0.79	11.00	13.00	23,400	3.68	13,500	2.42	8.0
	EHD2X24A**	MV12F19****	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.64	13,400	2.42	8.0
	EHD2X24A**	MV16J22****	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.74	13,500	2.46	8.0
	EHD2X24A**	MV20R26****	TDR&TXV	23,600	0.79	11.00	13.00	23,200	3.68	13,400	2.44	8.0
	EHD2X30A**	*8MPV050	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.56	13,700	2.38	8.0
	EHD2X30A**	*8MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.62	13,600	2.42	8.0
	EHD2X30A**	*8MPV100	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.68	13,600	2.46	8.0
	EHD2X30A**	*8MPV125	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.68	13,600	2.46	8.0
	EHD2X30A**	*9MPV050	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.50	13,500	2.36	8.0
	EHD2X30A**	*9MPV075	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.52	13,600	2.38	8.0
	EHD2X30A**	*9MPV100	TDR&TXV	23,800	0.79	11.00	13.00	23,200	3.62	13,600	2.42	8.0
	EHD2X30A**	*9MPV125	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.64	13,600	2.44	8.0
	EHD2X30A**	MV08B15****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.62	13,400	2.44	8.0
	EHD2X30A**	MV12F19****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.66	13,400	2.46	8.0
	EHD2X30A**	MV16J22****	TDR&TXV	23,800	0.79	11.00	13.00	22,800	3.72	13,500	2.48	8.0
EHD2X30A**	MV20R26****	TDR&TXV	23,800	0.79	11.00	13.00	23,000	3.70	13,400	2.48	8.0	
FEM2X30****		TDR&TXV	23,800	0.79	11.00	13.00	23,600	3.50	13,800	2.34	8.0	
FVM2X24****		TDR&TXV	23,600	0.79	11.00	13.00	23,000	3.60	13,300	2.40	8.0	
R2H330AKA	‡FEM2X30****		TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	18,000	2.36	8.0
	EB*2X30B**	MV08B15****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.42	18,100	2.38	8.0
	EB*2X30F**	*8MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	18,000	2.36	8.0
	EB*2X30F**	*9MPV050	TDR&TXV	29,200	0.79	10.50	13.00	29,600	3.32	18,100	2.32	7.9
	EB*2X30F**	*9MPV075	TDR&TXV	29,200	0.79	10.50	13.00	29,600	3.34	18,100	2.32	7.9
	EB*2X30F**	MV12F19****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.44	17,800	2.40	8.0
	EB*2X36B**	MV08B15****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.42	17,800	2.38	8.0
	EB*2X36F**	*8MPV075	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.44	18,100	2.38	8.0
	EB*2X36F**	*9MPV050	TDR&TXV	29,400	0.79	11.00	13.00	29,800	3.36	18,100	2.34	7.9
	EB*2X36F**	*9MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,800	3.38	18,100	2.34	8.0

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER	factory	BTU/hr	COP	BTU/hr	COP	
R2H330AKA (continued)	EB*2X36F**	MV12F19****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.48	17,800	2.42	8.0
	EB*2X36J**	*8MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.50	17,900	2.42	8.0
	EB*2X36J**	*8MPV125	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.52	17,900	2.44	8.0
	EB*2X36J**	*9MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.48	18,000	2.40	8.0
	EB*2X36J**	MV16J22****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.54	17,800	2.46	8.0
	ED*2X30B**	MV08B15****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.42	18,100	2.38	8.0
	ED*2X30F**	*8MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	18,000	2.36	8.0
	ED*2X30F**	*9MPV050	TDR&TXV	29,200	0.79	10.50	13.00	29,800	3.32	18,100	2.32	7.9
	ED*2X30F**	*9MPV075	TDR&TXV	29,200	0.79	10.50	13.00	29,800	3.34	18,100	2.32	7.9
	ED*2X30F**	MV12F19****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.44	17,800	2.40	8.0
	ED*2X36B**	MV08B15****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.42	17,800	2.38	8.0
	ED*2X36F**	*8MPV075	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.44	18,100	2.38	8.0
	ED*2X36F**	*9MPV050	TDR&TXV	29,400	0.79	11.00	13.00	29,800	3.36	18,100	2.34	7.9
	ED*2X36F**	*9MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,800	3.38	18,100	2.34	8.0
	ED*2X36F**	MV12F19****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.48	17,800	2.42	8.0
	ED*2X36J**	*8MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.50	17,900	2.42	8.0
	ED*2X36J**	*8MPV125	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.52	17,900	2.44	8.0
	ED*2X36J**	*9MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.48	18,000	2.40	8.0
	ED*2X36J**	MV16J22****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.54	17,800	2.46	8.0
	EHD2X30A**	*8MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	18,000	2.36	8.0
	EHD2X30A**	*8MPV100	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.42	17,900	2.38	8.0
	EHD2X30A**	*8MPV125	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.42	17,900	2.38	8.0
	EHD2X30A**	*9MPV050	TDR&TXV	29,200	0.79	10.50	13.00	29,600	3.32	18,100	2.32	7.9
	EHD2X30A**	*9MPV075	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.34	18,100	2.32	7.9
	EHD2X30A**	*9MPV100	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	18,000	2.36	8.0
	EHD2X30A**	*9MPV125	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.40	17,900	2.36	8.0
	EHD2X30A**	MV08B15****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.46	18,100	2.40	8.0
	EHD2X30A**	MV12F19****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.44	17,800	2.40	8.0
	EHD2X30A**	MV16J22****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.46	17,800	2.40	8.0
	EHD2X30A**	MV20R26****	TDR&TXV	29,400	0.79	11.00	13.00	29,600	3.46	17,700	2.40	8.0
	EHD2X36A**	*8MPV050	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.48	18,400	2.36	8.0
	EHD2X36A**	*8MPV075	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.58	18,100	2.42	8.0
EHD2X36A**	*8MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.62	18,000	2.44	8.0	
EHD2X36A**	*8MPV125	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.62	17,900	2.44	8.0	
EHD2X36A**	*9MPV050	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.50	18,100	2.36	8.0	
EHD2X36A**	*9MPV075	TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.50	18,200	2.38	8.0	
EHD2X36A**	*9MPV100	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.58	18,100	2.42	8.0	
EHD2X36A**	*9MPV125	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.60	18,000	2.44	8.0	
EHD2X36A**	MV08B15****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.60	17,900	2.42	8.0	

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER factory	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER		BTU/hr	COP	BTU/hr	COP	
R2H330AKA (continued)	EHD2X36A**	MV12F19****	TDR&TXV	29,600	0.79	11.00	13.00	29,600	3.62	17,900	2.44	8.0
	EHD2X36A**	MV16J22****	TDR&TXV	29,600	0.79	11.00	13.00	29,400	3.66	17,800	2.46	8.0
	EHD2X36A**	MV20R26****	TDR&TXV	29,600	0.79	11.00	13.00	29,400	3.66	17,800	2.48	8.0
	FEM2X35****		TDR&TXV	29,600	0.79	11.00	13.00	29,800	3.42	18,100	2.38	8.0
	FEM2X36****		TDR&TXV	29,600	0.79	11.00	13.00	29,200	3.54	18,200	2.40	8.0
	FVM2X24****		TDR&TXV	29,200	0.79	11.00	13.00	29,200	3.48	17,800	2.38	8.0
	FVM2X36****		TDR&TXV	29,600	0.79	11.00	13.00	29,400	3.42	17,600	2.40	8.0
R2H336AKA	‡FEM2X35****		TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.62	22,400	2.56	8.0
	EB*2X36B**	MV08B15****	TDR&TXV	34,600	0.79	11.00	13.00	35,600	3.56	22,200	2.52	8.0
	EB*2X36F**	*8MPV075	TDR&TXV	34,600	0.79	11.00	13.00	35,600	3.56	22,400	2.52	8.0
	EB*2X36F**	*9MPV075	TDR&TXV	34,200	0.79	10.50	13.00	35,600	3.48	22,400	2.48	8.0
	EB*2X36F**	MV12F19****	TDR&TXV	34,800	0.79	11.00	13.00	35,600	3.60	22,000	2.56	8.0
	EB*2X36J**	*8MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.66	22,400	2.58	8.0
	EB*2X36J**	*8MPV125	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.68	22,200	2.58	8.0
	EB*2X36J**	*9MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.62	22,400	2.56	8.0
	EB*2X36J**	MV16J22****	TDR&TXV	34,800	0.79	11.00	13.00	35,600	3.64	21,800	2.60	8.0
	EB*2X42J**	*8MPV100	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.74	22,400	2.60	8.0
	EB*2X42J**	*8MPV125	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.74	22,200	2.60	8.0
	EB*2X42J**	*9MPV100	TDR&TXV	35,200	0.79	11.00	13.00	36,000	3.70	22,400	2.56	8.0
	EB*2X42J**	MV16J22****	TDR&TXV	35,200	0.79	11.00	13.00	35,600	3.70	22,000	2.60	8.0
	EB*2X42L**	*9MPV125	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.72	22,400	2.60	8.0
	ED*2X36B**	MV08B15****	TDR&TXV	34,600	0.79	11.00	13.00	35,600	3.56	22,200	2.52	8.0
	ED*2X36F**	*8MPV075	TDR&TXV	34,600	0.79	11.00	13.00	35,600	3.56	22,400	2.52	8.0
	ED*2X36F**	*9MPV075	TDR&TXV	34,200	0.79	10.50	13.00	35,600	3.48	22,400	2.48	8.0
	ED*2X36F**	MV12F19****	TDR&TXV	34,800	0.79	11.00	13.00	35,600	3.60	22,000	2.56	8.0
	ED*2X36J**	*8MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.66	22,400	2.58	8.0
	ED*2X36J**	*8MPV125	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.68	22,200	2.58	8.0
	ED*2X36J**	*9MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.62	22,400	2.56	8.0
	ED*2X36J**	MV16J22****	TDR&TXV	34,800	0.79	11.00	13.00	35,600	3.64	21,800	2.60	8.0
	ED*2X42J**	*8MPV100	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.74	22,400	2.60	8.0
	ED*2X42J**	*8MPV125	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.74	22,200	2.60	8.0
	ED*2X42J**	*9MPV100	TDR&TXV	35,200	0.79	11.00	13.00	36,000	3.70	22,400	2.56	8.0
	ED*2X42J**	MV16J22****	TDR&TXV	35,200	0.79	11.00	13.00	35,600	3.70	22,000	2.60	8.0
	ED*2X42L**	*9MPV125	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.72	22,400	2.60	8.0
	EHD2X36A**	*8MPV050	TDR&TXV	35,000	0.79	10.50	13.00	35,600	3.58	22,600	2.48	8.0
	EHD2X36A**	*8MPV075	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.72	22,400	2.56	8.0
	EHD2X36A**	*8MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.78	22,400	2.60	8.0
EHD2X36A**	*8MPV125	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.80	22,400	2.62	8.0	
EHD2X36A**	*9MPV050	TDR&TXV	35,000	0.79	11.00	13.00	35,400	3.60	22,600	2.50	8.0	

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER	factory	BTU/hr	COP	BTU/hr	COP	
R2H336AKA (continued)	EHD2X36A**	*9MPV075	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.64	22,600	2.52	8.0
	EHD2X36A**	*9MPV100	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.74	22,400	2.58	8.0
	EHD2X36A**	*9MPV125	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.76	22,400	2.60	8.0
	EHD2X36A**	MV08B15****	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.76	22,400	2.58	8.0
	EHD2X36A**	MV12F19****	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.80	22,400	2.62	8.0
	EHD2X36A**	MV16J22****	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.76	22,000	2.62	8.0
	EHD2X36A**	MV20R26****	TDR&TXV	35,000	0.79	11.00	13.00	35,600	3.76	21,800	2.62	8.0
	EHD2X42A**	*8MPV050	TDR&TXV	35,200	0.79	11.00	13.00	36,000	3.62	22,600	2.50	8.0
	EHD2X42A**	*8MPV075	TDR&TXV	35,600	0.79	11.00	13.00	35,800	3.76	22,400	2.58	8.0
	EHD2X42A**	*8MPV100	TDR&TXV	35,600	0.79	11.00	13.00	35,400	3.80	22,400	2.62	8.0
	EHD2X42A**	*8MPV125	TDR&TXV	35,600	0.79	11.00	13.00	35,400	3.82	22,400	2.64	8.0
	EHD2X42A**	*9MPV050	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.64	22,600	2.50	8.0
	EHD2X42A**	*9MPV075	TDR&TXV	35,400	0.79	11.00	13.00	36,000	3.68	22,600	2.54	8.0
	EHD2X42A**	*9MPV100	TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.76	22,600	2.60	8.0
	EHD2X42A**	*9MPV125	TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.80	22,400	2.62	8.0
	EHD2X42A**	MV08B15****	TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.78	22,400	2.60	8.0
	EHD2X42A**	MV12F19****	TDR&TXV	35,600	0.79	11.00	13.00	35,400	3.82	22,400	2.64	8.0
	EHD2X42A**	MV16J22****	TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.82	22,000	2.64	8.0
	EHD2X42A**	MV20R26****	TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.84	22,000	2.64	8.0
	FEM2X36****		TDR&TXV	35,600	0.79	11.00	13.00	35,000	3.74	22,400	2.58	8.0
FEM2X42****		TDR&TXV	35,600	0.79	11.00	13.00	35,600	3.76	22,400	2.60	8.0	
FVM2X24****		TDR&TXV	34,400	0.79	11.00	13.00	35,000	3.60	22,200	2.52	8.0	
FVM2X36****		TDR&TXV	34,800	0.79	11.00	13.00	35,400	3.58	21,800	2.56	8.0	
R2H342AKA	‡FEM2X42****		TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.58	27,200	2.62	8.0
	EB*2X42J**	*8MPV100	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.52	26,200	2.64	8.0
	EB*2X42J**	*8MPV125	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.52	26,200	2.66	8.0
	EB*2X42J**	*9MPV100	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.48	26,400	2.62	8.0
	EB*2X42J**	MV16J22****	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.60	26,200	2.70	8.0
	EB*2X42L**	*9MPV125	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.54	26,400	2.64	8.0
	EB*2X48F**	*8MPV075	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,800	2.66	8.0
	EB*2X48J**	*8MPV100	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,400	2.70	8.0
	EB*2X48J**	*8MPV125	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,200	2.70	8.0
	EB*2X48J**	*9MPV100	TDR&TXV	40,500	0.81	11.00	13.00	42,500	3.60	26,400	2.66	8.0
	EB*2X48J**	MV16J22****	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.74	26,400	2.76	8.0
	EB*2X48L**	*9MPV125	TDR&TXV	40,500	0.81	11.00	13.00	42,500	3.62	26,400	2.68	8.0
	ED*2X42J**	*8MPV100	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.52	26,200	2.64	8.0
	ED*2X42J**	*8MPV125	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.52	26,200	2.66	8.0
	ED*2X42J**	*9MPV100	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.48	26,400	2.62	8.0
	ED*2X42J**	MV16J22****	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.60	26,200	2.70	8.0

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER factory	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER		BTU/hr	COP	BTU/hr	COP	
R2H342AKA (continued)	ED*2X42L**	*9MPV125	TDR&TXV	40,000	0.81	11.00	13.00	42,000	3.50	26,200	2.64	8.0
	ED*2X48F**	*8MPV075	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,800	2.66	8.0
	ED*2X48J**	*8MPV100	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,400	2.70	8.0
	ED*2X48J**	*8MPV125	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.64	26,200	2.70	8.0
	ED*2X48J**	*9MPV100	TDR&TXV	40,500	0.81	11.00	13.00	42,500	3.60	26,400	2.66	8.0
	ED*2X48J**	MV16J22****	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.74	26,400	2.76	8.0
	ED*2X48L**	*9MPV125	TDR&TXV	40,500	0.81	11.00	13.00	42,500	3.62	26,400	2.68	8.0
	EHD2X42A**	*8MPV075	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.60	26,800	2.64	8.0
	EHD2X42A**	*8MPV100	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.64	26,400	2.68	8.0
	EHD2X42A**	*8MPV125	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.68	26,600	2.70	8.0
	EHD2X42A**	*9MPV100	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.64	26,800	2.68	8.0
	EHD2X42A**	*9MPV125	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.64	26,600	2.68	8.0
	EHD2X42A**	MV16J22****	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.74	26,400	2.74	8.0
	EHD2X42A**	MV20R26****	TDR&TXV	40,500	0.81	11.00	13.00	42,000	3.74	26,400	2.74	8.0
	EHD2X48A**	*8MPV075	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.62	26,800	2.66	8.0
	EHD2X48A**	*8MPV100	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.66	26,400	2.70	8.0
	EHD2X48A**	*8MPV125	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.72	26,600	2.72	8.0
	EHD2X48A**	*9MPV075	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.54	27,200	2.60	8.0
	EHD2X48A**	*9MPV100	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.66	26,800	2.68	8.0
	EHD2X48A**	*9MPV125	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.68	26,600	2.70	8.0
EHD2X48A**	MV16J22****	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.76	26,400	2.76	8.0	
EHD2X48A**	MV20R26****	TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.76	26,400	2.76	8.0	
FEM2X48****		TDR&TXV	41,000	0.81	11.00	13.00	42,500	3.72	27,400	2.68	8.0	
FVM2X36****		TDR&TXV	40,000	0.81	11.00	13.00	41,500	3.46	26,200	2.62	8.0	
FVM2X48****		TDR&TXV	41,000	0.81	11.00	13.00	43,000	3.70	26,200	2.74	8.0	
R2H348AKA	‡FEM2X48****		TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.56	32,800	2.50	8.0
	EB*2X48J**	MV16J22****	TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.52	32,800	2.50	8.0
	EB*2X60J**	*8MPV100	TDR&TXV	47,000	0.75	11.00	13.00	55,500	3.54	33,400	2.48	8.0
	EB*2X60J**	*8MPV125	TDR&TXV	47,000	0.75	11.00	13.00	55,500	3.54	33,400	2.50	8.0
	EB*2X60J**	MV16J22****	TDR&TXV	47,000	0.75	11.00	13.00	48,500	3.60	33,000	2.54	8.0
	ED*2X48J**	MV16J22****	TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.52	32,800	2.50	8.0
	ED*2X60J**	*8MPV100	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.54	33,400	2.48	8.0
	ED*2X60J**	*8MPV125	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.54	33,400	2.50	8.0
	ED*2X60J**	MV16J22****	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.60	33,000	2.54	8.0
	EHD2X48A**	MV16J22****	TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.56	33,000	2.50	8.0
	EHD2X48A**	MV20R26****	TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.64	33,400	2.52	8.0
	EHD2X60A**	*8MPV100	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.58	33,600	2.50	8.0
	EHD2X60A**	*8MPV125	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.60	33,400	2.50	8.0

- continued on next page -

COOLING & HEATING PERFORMANCE FOR COMBINATION RATINGS (continued)
Current Indoor Models

Outdoor Model	Current Indoor Model (‡ tested combo)	Furnace Model	Factory Installed	Cool (95° F)			SEER	Heat (47° F)		Heat (17° F)		HSPF
				BTU/hr	S / T	EER	factory	BTU/hr	COP	BTU/hr	COP	
R2H348AKA (continued)	EHD2X60A**	*9MPV125	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.54	33,600	2.48	8.0
	EHD2X60A**	MV16J22****	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.64	33,000	2.54	8.0
	EHD2X60A**	MV20R26****	TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.72	33,400	2.56	8.0
	FEM2X60****		TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.52	33,400	2.46	8.0
	FVM2X48****		TDR&TXV	47,000	0.75	11.00	13.00	48,000	3.50	32,800	2.48	7.9
	FVM2X60****		TDR&TXV	47,500	0.75	11.00	13.00	48,500	3.62	32,800	2.54	8.0
R2H360AKA	‡FEM2X60****		TDR&TXV	54,000	0.77	11.00	13.00	55,000	3.56	32,800	2.50	8.0
	EB*2X60J**	MV16J22****	TDR&TXV	53,500	0.77	11.00	13.00	54,500	3.48	32,600	2.48	7.9
	EHD2X60A**	MV20R26****	TDR&TXV	53,500	0.77	11.00	13.00	54,500	3.52	32,600	2.50	8.0
	FVM2X60****		TDR&TXV	54,000	0.77	11.00	13.00	55,000	3.54	33,000	2.50	8.0

OUTDOOR UNIT MODEL NUMBER IDENTIFICATION GUIDE (single phase)											
Digit Position:	1	2	3	4	5, 6	7	8	9	10	11	12
Example Part Number:	R	2	H	3	18	A	K	A	1	0	0
Product Family	REFRIGERANT		TYPE								
2 = R-22											
4 = R-410A											
A = Air Conditioner											
H = Heat Pump											
3 = 13 SEER											
4 = 14 SEER			NOMINAL EFFICIENCY								
18 = 18,000 BTUH = 1½ tons											
24 = 24,000 BTUH = 2 tons											
30 = 30,000 BTUH = 2½ tons											
36 = 36,000 BTUH = 3 tons											
42 = 42,000 BTUH = 3½ tons											
48 = 48,000 BTUH = 4 tons											
60 = 60,000 BTUH = 5 tons			NOMINAL CAPACITY								
A = Standard Grille											
G = Coil Guard Grille						FEATURES					
K = 208/230-1-60									VOLTAGE		
Sales Code											
Engineering Revision											
Extra Digit											
Extra Digit											

ACCESSORIES PART NUMBER IDENTIFICATION GUIDE									
Digit Position:	1	2	3	4	5	6, 7	8, 9	10, 11	
Example Part Number:	N	A	S	A	0	01	01	CH	
N = Non-Branded	BRANDING								
A = Accessory	PRODUCT GROUP								
S = Split System (AC & HP)				KIT USAGE					
A = Original									
B = 2nd Generation				MAJOR SERIES					
0 = Generic or Not Applicable									
2 = R-22									
4 = R-410A				REFRIGERANT					
Product Identifier Number									
Package Quantity									
Type of Kit (Example: CH = Crankcase Heater)									